




ELLIS

Holding Power

DATA SHEET

VULCAN+™ SINGLE/TREFOIL

- 316L STAINLESS STEEL FRAME AND FIXINGS
- SOFT LSF POLYMERIC LINER PROTECTS CABLE SHEATH
- CAPTIVE CLOSURE FIXINGS FOR FAST INSTALL
- SHORT CIRCUIT AND MECHANICALLY TESTED TO IEC 61914
- ABS AND DNV TYPE APPROVED AND ALSO UL LISTED

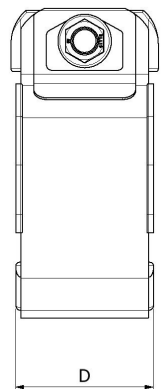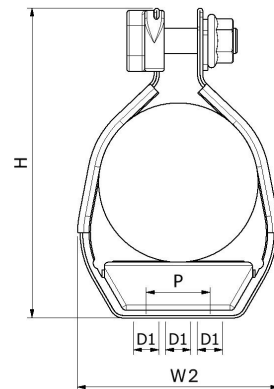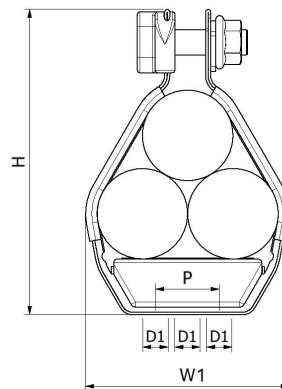

PART NO.	CABLE RANGE TREFOIL		CABLE RANGE SINGLE		DIMENSIONS (mm)						WEIGHT (g)
	MIN ϕ (mm)	MAX ϕ (mm)	MIN ϕ (mm)	MAX ϕ (mm)	W1 Max	W2 Max	D ± 1	H ± 5	P ± 0.5	FIXING HOLES (D1)	
VRT+00C	10	15	-	-	57	-	56	94	N/A	1 x M10	276
VRT+00B	-	-	18	28	-	60	54	90	N/A	1 x M10	280
VRT+00A	15	18	26	30	60	60	54	93	N/A	1 x M10	287
VRT+00	19	24	30	42	60	60	54	92	N/A	1 x M10	251
VRT+01	23	28	38	50	66	60	54	100	N/A	1 x M10	258
VRT+02	27	32	43	58	74	68	54	108	N/A	1 x M10	269
VRT+03	30	35	49	64	80	74	54	113	N/A	1 x M10	279
VRT+04	33	38	55	70	86	80	54	119	N/A	1 x M10	284
VRT+05	36	42	58	75	94	85	54	125	N/A	1 x M10	319
VRT+06	40	46	63	84	102	94	54	134	N/A	1 x M10	331
VRT+07	44	50	73	90	110	103	54	140	N/A	1 x M10	391
VRT+08	48	55	83	100	120	110	54	151	N/A	1 x M10	405
VRT+09	51	58	86	104	126	114	54	156	N/A	1 x M10	411
VRT+10	55	62	88	110	134	123	54	162	50	3 x M10	442
VRT+11	59	66	90	115	142	125	54	168	50	3 x M10	453
VRT+12	63	70	100	125	150	135	54	178	50	3 x M10	460
VRT+13	67	74	107	132	158	146	54	185	75	3 x M10	524
VRT+14	71	78	120	145	166	155	54	196	75	3 x M10	536
VRT+15	74	82	125	150	174	160	54	202	75	3 x M10	542
VRT+16	77	85	132	153	180	163	54	206	75	3 x M10	544
VRT+17	81	89	136	156	188	172	54	212	75	3 x M10	618
VRT+18	85	93	139	159	196	172	54	217	75	3 x M10	628
VRT+19	89	97	142	162	204	172	54	222	75	3 x M10	637
VRT+20	93	101	160	170	212	180	54	230	75	3 x M10	646

ELLIS

Holding Power


DATA SHEET

VULCAN+™ SINGLE/TREFOIL


TESTING SUMMARY

Vulcan+ Cleats have been tested in line with the International Standard 'Cable Cleats for Electrical Installations' IEC 61914:2021. Typical results are detailed below, please note that these testing values are maximums and safety factors appropriate to your application should be used:

PROPERTY	CLASSIFICATION CLAUSE IEC 61914	UNITS / CLASSIFICATION	TEST DATA
CLEAT TYPE	6.1.3	COMPOSITE	-
TEMP. FOR PERMANENT APPLICATION	6.2	°C	-40 - 60
UV RESISTANCE	6.5.1.2	XENON ARC METHOD A	PASS
CORROSION RESISTANCE	6.5.2.2	HIGH	316L STAINLESS STEEL HAS ≥16% CHROMIUM
IMPACT RATING	6.3.4	VERY HEAVY	PASS
FLAME PROPAGATION TEST	10.0, 10.1	APPLICATION TIME ≥30s	PASS
AXIAL LOAD RATING	6.4.3, 9.4	NEWTONS (N)	280N - TREFOIL (VRT+00C/A = 80N) 110N - SINGLE (VRT+00B = 60N)
LATERAL LOAD RATING	6.4.2, 9.3	NEWTONS (N)	HORIZONTAL - 200N (VRT+00C = 180N) VERTICAL - 650N (VRT+00B = 350N)
RESISTANCE TO ELECTROMECHANICAL FORCE (SHORT CIRCUIT TESTING)	6.4, 6.4.5, 9.5	CLEATS AT 300MM INTERVALS (WITHSTANDING MORE THAN ONE SHORT CIRCUIT)	135kA (REPORT No. LCOE 2025 09 3S 0695-7) CABLE OD= Ø35.5mm
RESISTANCE TO ELECTROMECHANICAL FORCE (SHORT CIRCUIT TESTING)	6.4, 6.4.5, 9.5	CLEATS AT 600MM INTERVALS (WITHSTANDING MORE THAN ONE SHORT CIRCUIT)	116kA (REPORT No. LCOE 2025 09 3S 0695-8) CABLE OD= Ø35.7mm
RESISTANCE TO ELECTROMECHANICAL FORCE (SHORT CIRCUIT TESTING)	6.4, 6.4.5, 9.5	CLEATS AT 300MM INTERVALS (WITHSTANDING MORE THAN ONE SHORT CIRCUIT) SINGLE FORMATION	135kA (REPORT No. PDL- 22.079.04) CABLE OD= Ø36mm PHASE SPACING = 125mm
RESISTANCE TO ELECTROMECHANICAL FORCE (SHORT CIRCUIT TESTING)	6.4, 6.4.5, 9.5	CLEATS AT 600MM INTERVALS (WITHSTANDING MORE THAN ONE SHORT CIRCUIT) SINGLE FORMATION	149kA (REPORT No. LCOE 2025 09 3S 0695-3) CABLE OD= Ø35.1mm PHASE SPACING = 125mm



LATERAL LOAD 'VERTICAL'
DIRECTION



LATERAL LOAD 'HORIZONTAL'
DIRECTION

Listed sizes:
VRT+00 to
VRT+20



Conduit & cable hardware 4CG8 with
AH-2 & wet locations. Listed sizes:
VRT+00 to VRT+18.

LONDON UNDERGROUND
Vulcan+ Cable Cleats are compliant
with the requirements of LUL-1085.
Product register number 361.

This data sheet is subject to change without notice. The information provided has been generated in laboratory conditions, as such results in use may vary.

ELLIS PATENTS LTD.

www.ellispatents.co.uk

ISSUE 09 13/10/25

2 / 2